DUNDALK, MD.

"N"
JUNE, 1955

All information contained in this map, covering properties that might be related to National Defense activities, is to be treated as **strictly confidential** by our subscribers and not divulged to any outside interests. The U. S. Espionage Act makes it incumbent upon possessors of information relating to National Defense to take all possible precautions to prevent it from falling into the hands of interests inimical to the United States. Tracings or other reproductions of Sanborn Maps in full or in part are prohibited.

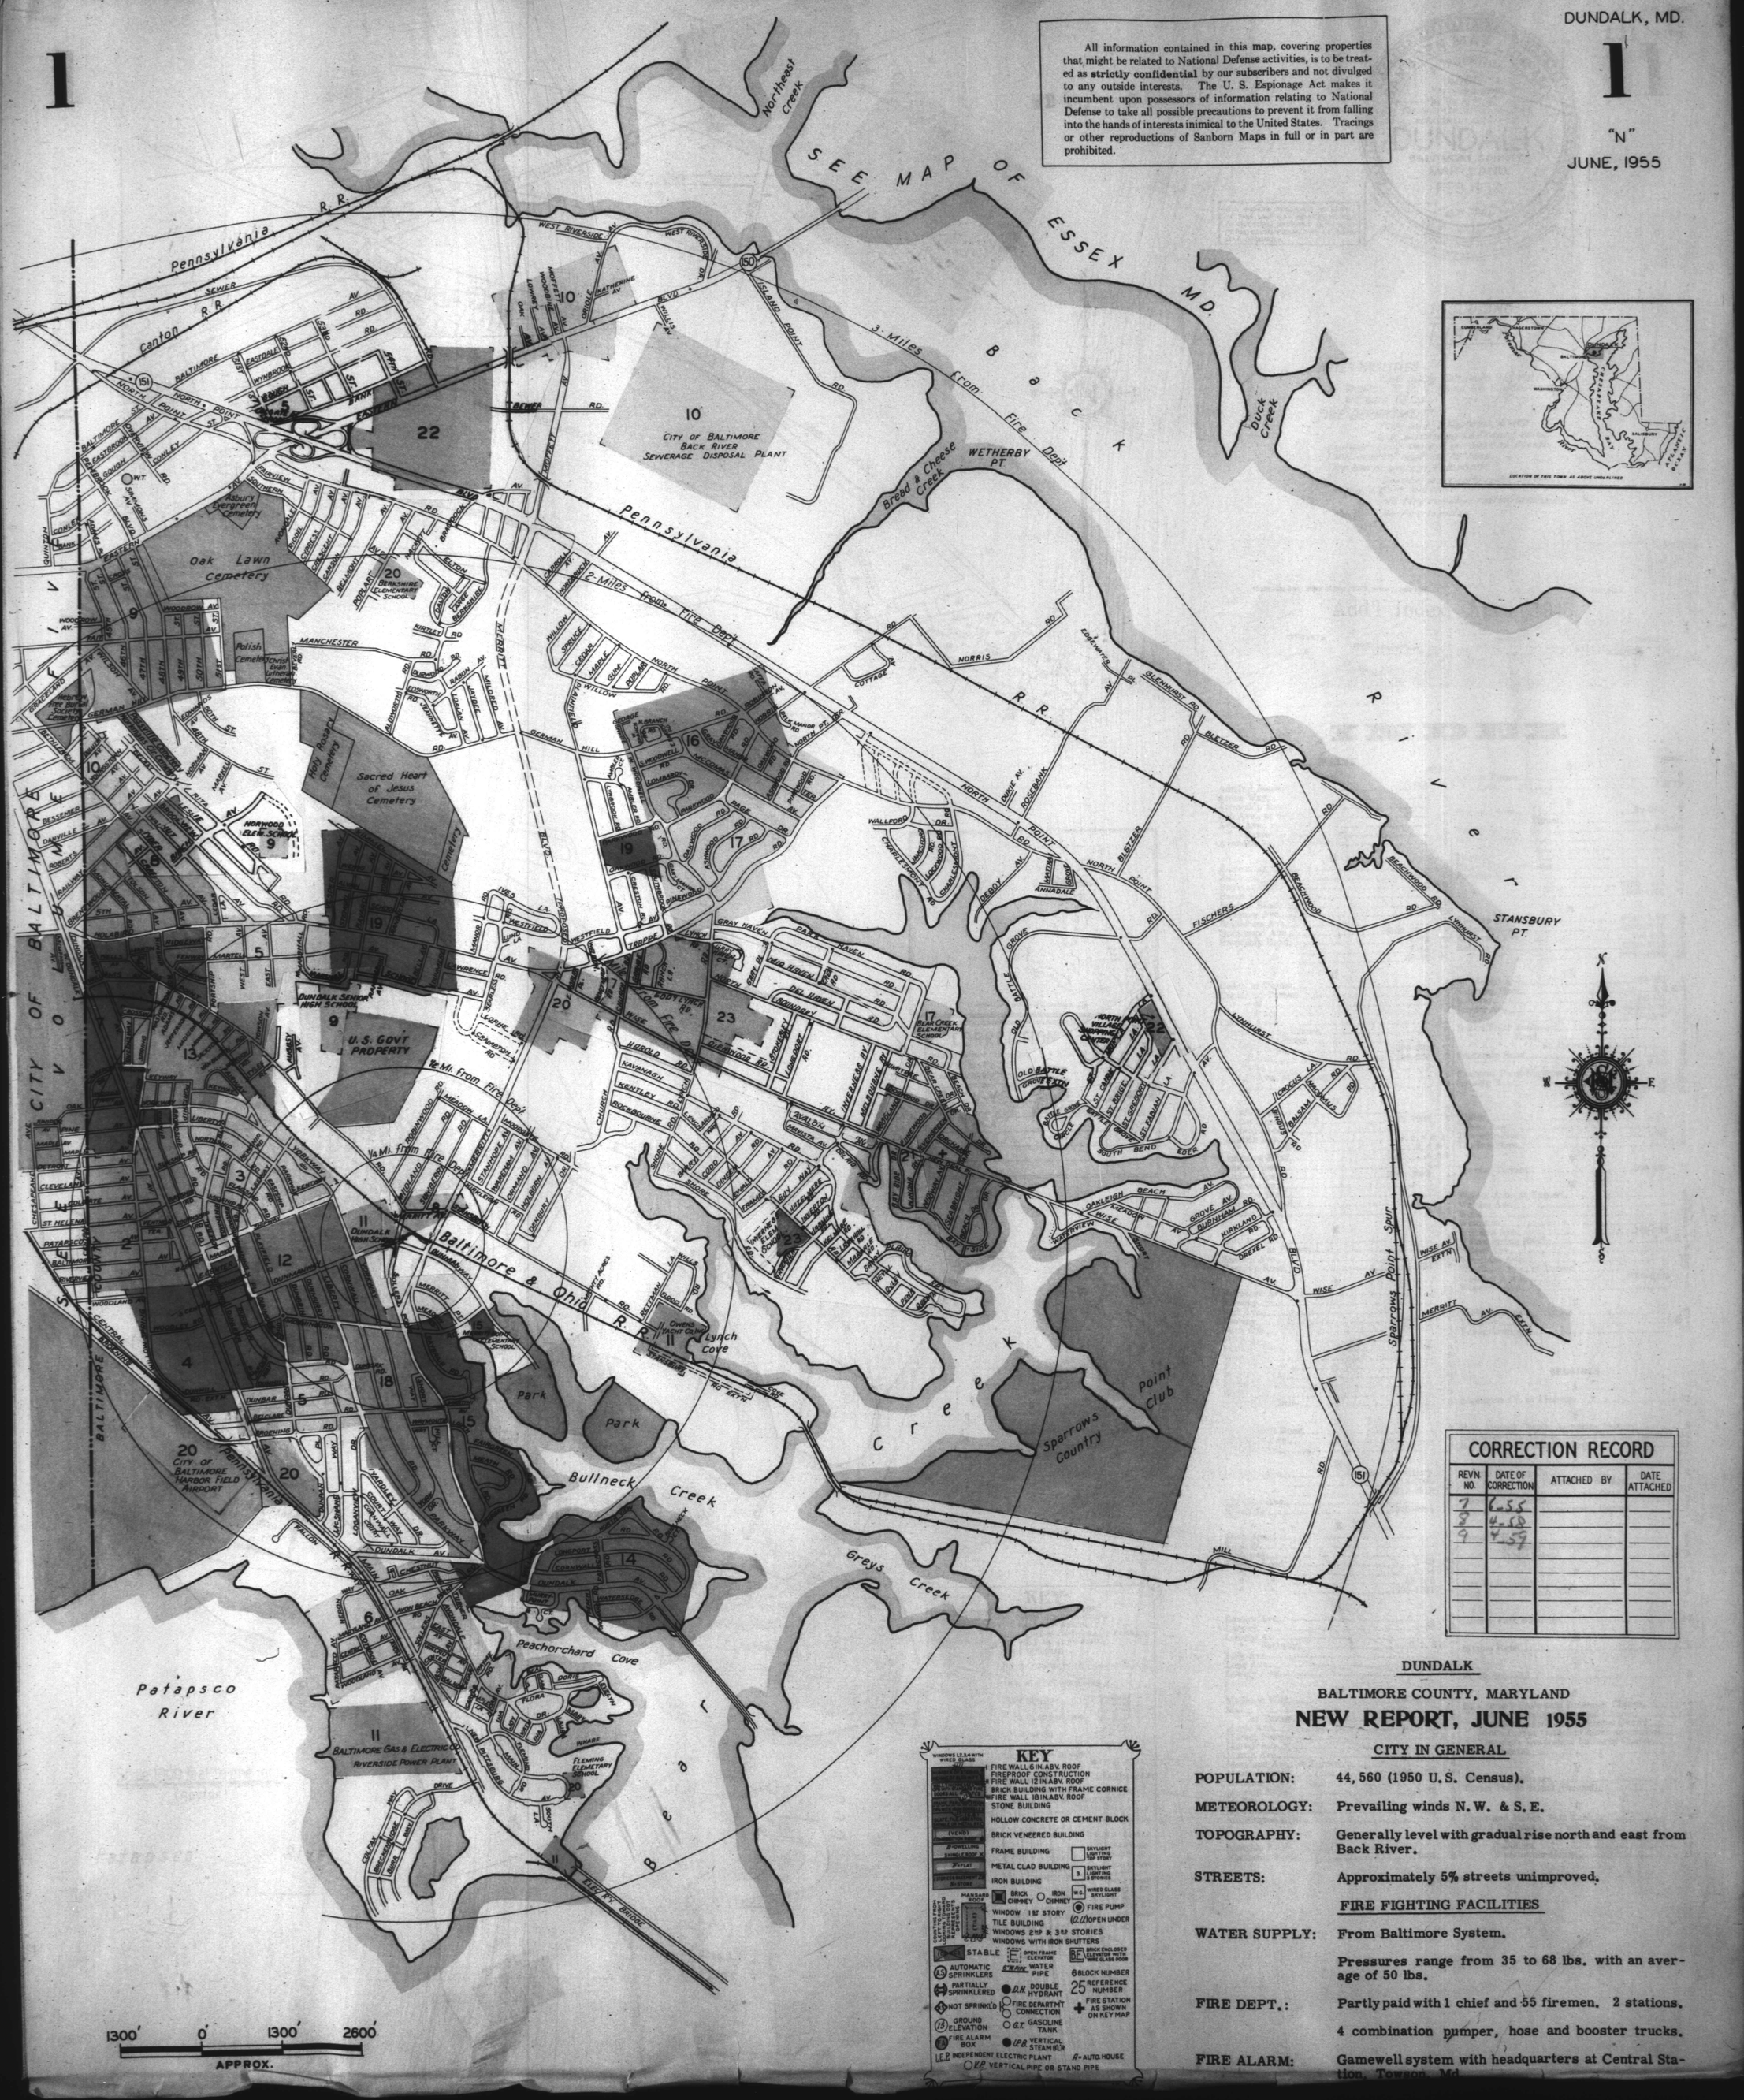

CORRECTION RECORD

REV'N. NO.	DATE OF CORRECTION	ATTACHED BY	DATE ATTACHED
7	6-55		
8	4-58		
9	4-59		

DUNDALK

BALTIMORE COUNTY, MARYLAND

NEW REPORT, JUNE 1955

CITY IN GENERAL

POPULATION: 44,560 (1950 U.S. Census).

METEOROLOGY: Prevailing winds N.W. & S.E.

TOPOGRAPHY: Generally level with gradual rise north and east from Back River.

STREETS: Approximately 5% streets unimproved.

FIRE FIGHTING FACILITIES

WATER SUPPLY: From Baltimore System.

Pressures range from 35 to 68 lbs. with an average of 50 lbs.

FIRE DEPT.: Partly paid with 1 chief and 55 firemen. 2 stations.

4 combination pumper, hose and booster trucks.

FIRE ALARM: Gamewell system with headquarters at Central Station, Towson, Md.

KEY

- FIRE WALL 6 IN. ABV. ROOF
- FIREPROOF CONSTRUCTION
- FIRE WALL 12 IN. ABV. ROOF
- BRICK BUILDING WITH FRAME CORNICE
- FIRE WALL 18 IN. ABV. ROOF
- STONE BUILDING
- HOLLOW CONCRETE OR CEMENT BLOCK
- BRICK VENEERED BUILDING
- FRAME BUILDING
- METAL CLAD BUILDING
- IRON BUILDING
- BRICK CHIMNEY / IRON CHIMNEY
- WINDOW 1ST STORY
- TILE BUILDING
- WINDOWS 2ND & 3RD STORIES
- WINDOWS WITH IRON SHUTTERS
- STABLE
- OPEN FRAME ELEVATOR
- BRICK ENCLOSED ELEVATOR WITH WIRE GLASS DOOR
- AUTOMATIC SPRINKLERS
- PARTIALLY SPRINKLERED
- NOT SPRINKLED
- GROUND ELEVATION
- FIRE ALARM BOX
- WATER PIPE
- DOUBLE HYDRANT
- FIRE DEPARTMT CONNECTION
- GASOLINE TANK
- VERTICAL STEAM BLR
- BLOCK NUMBER
- REFERENCE NUMBER
- FIRE STATION AS SHOWN ON KEY MAP
- I.E.P. INDEPENDENT ELECTRIC PLANT
- A = AUTO. HOUSE
- V.P. VERTICAL PIPE OR STAND PIPE