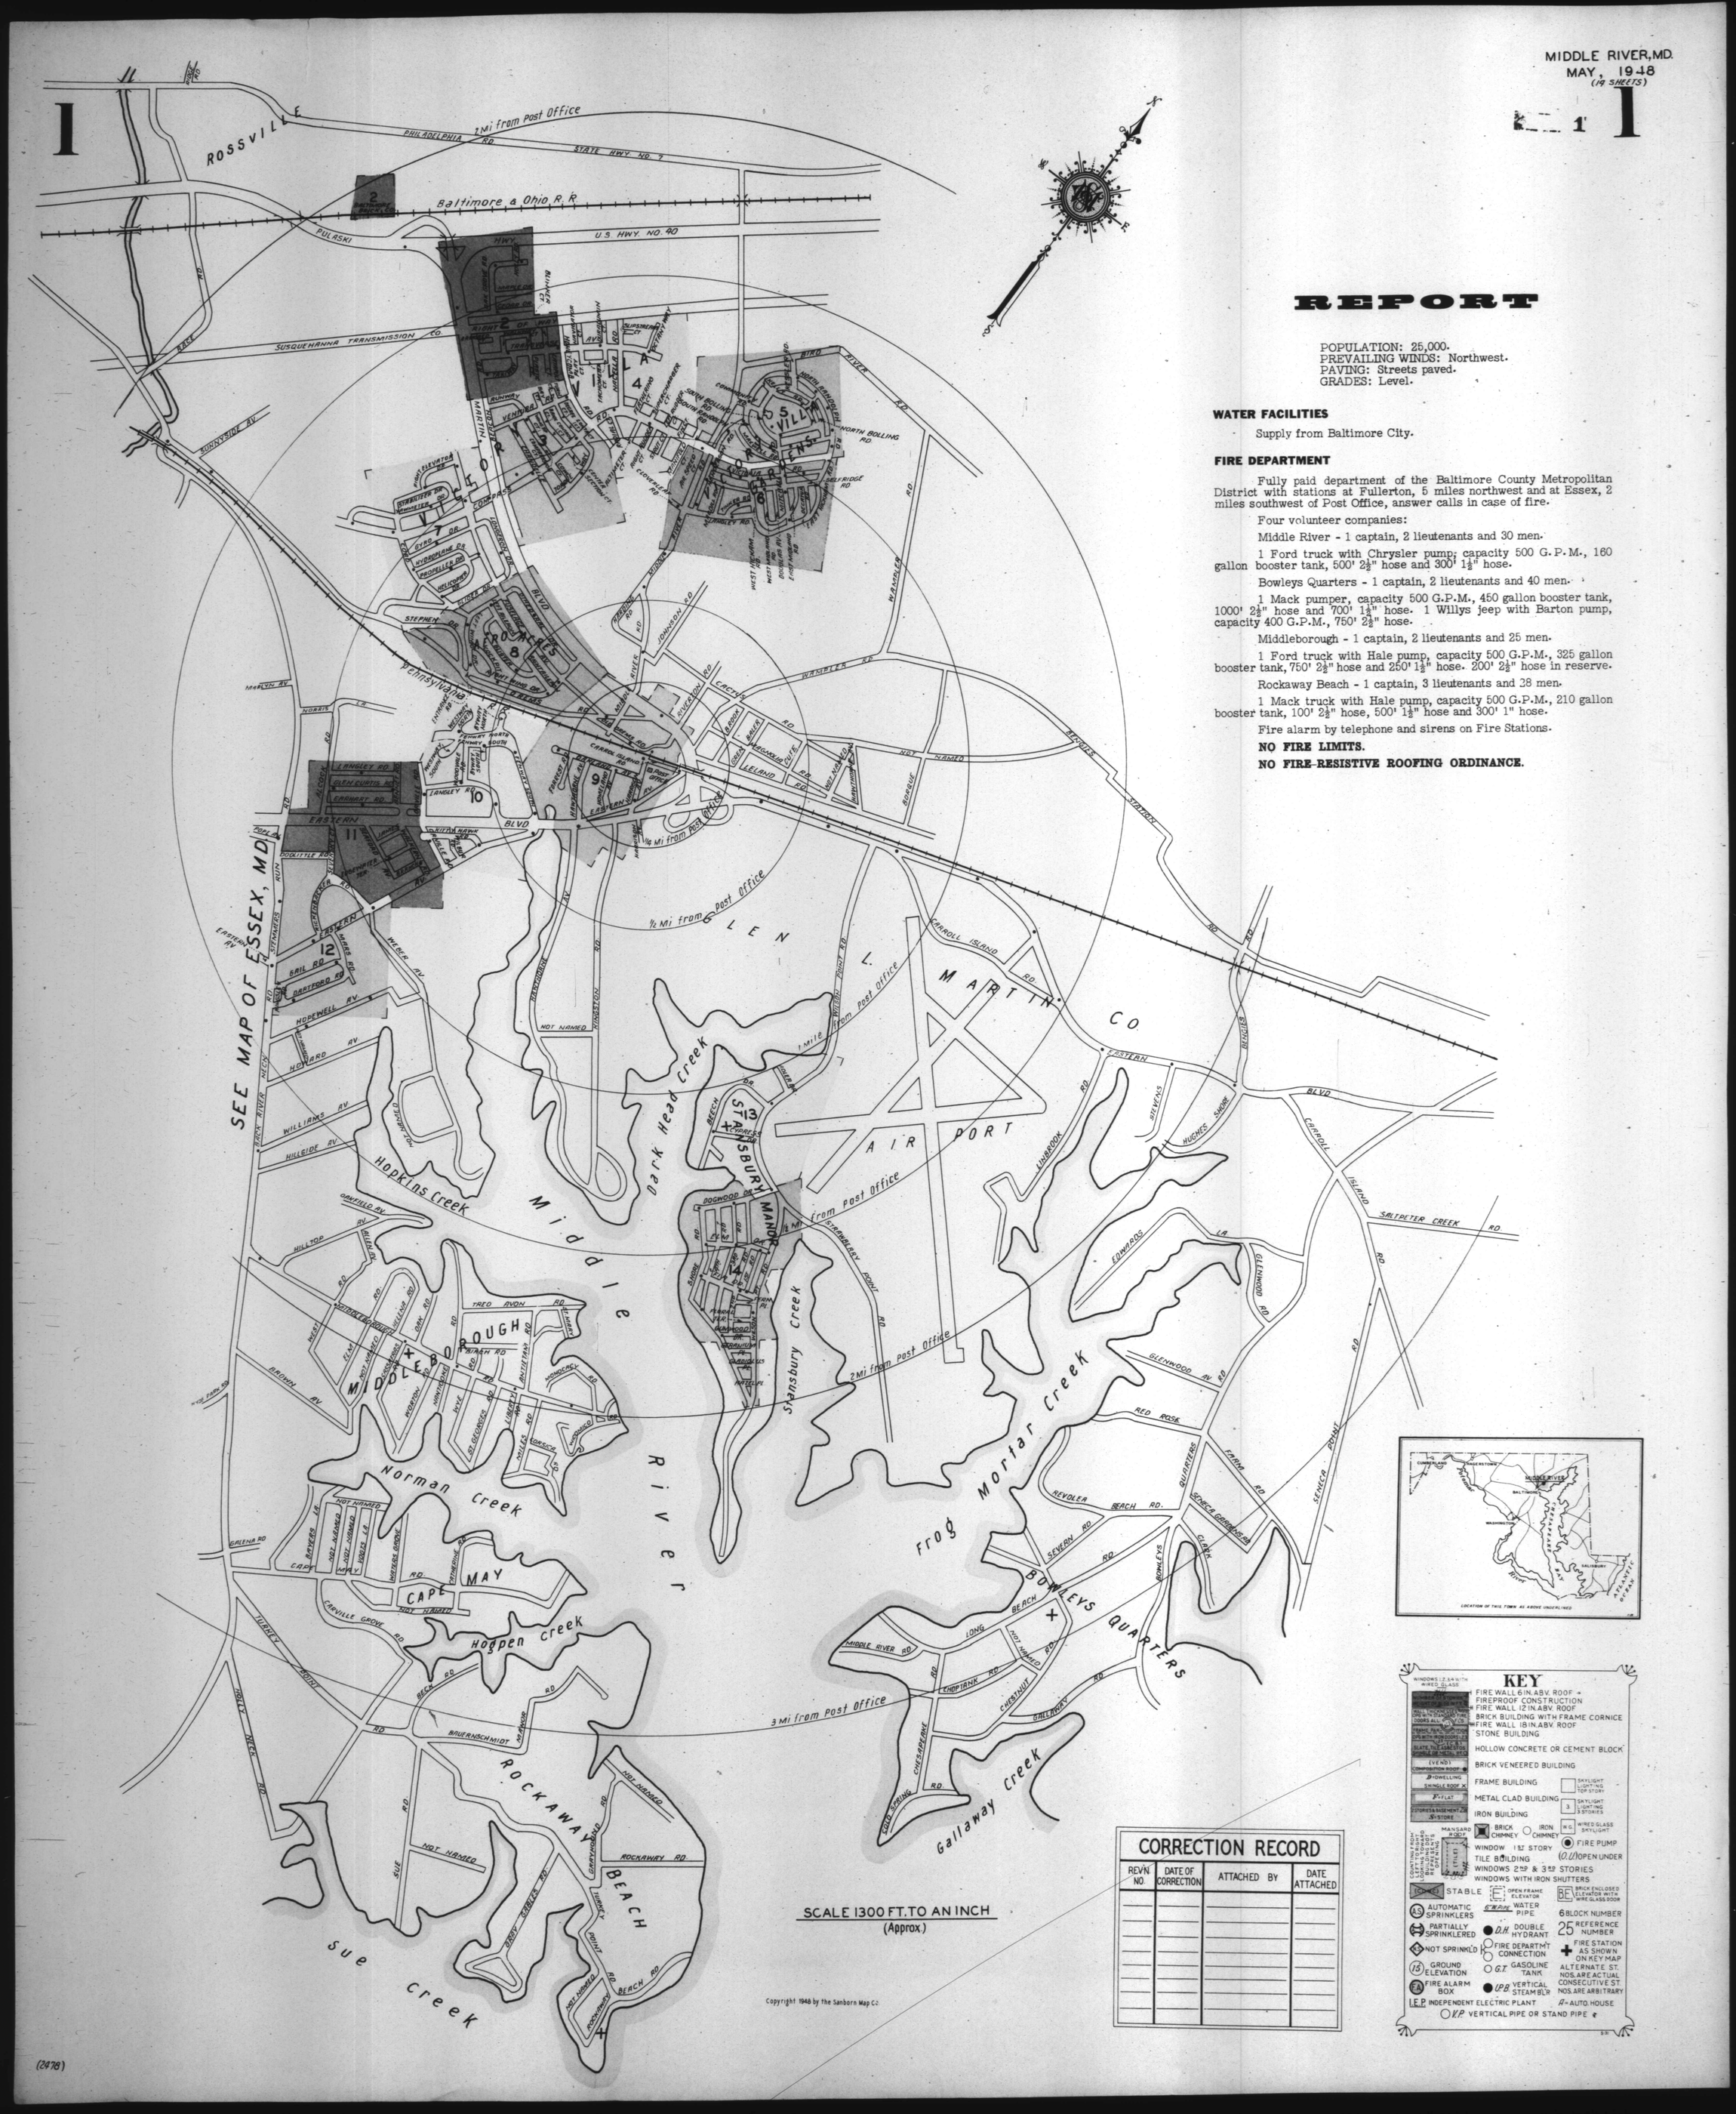

REPORT

POPULATION: 25,000.
PREVAILING WINDS: Northwest.
PAVING: Streets paved.
GRADES: Level.

WATER FACILITIES

Supply from Baltimore City.

FIRE DEPARTMENT

Fully paid department of the Baltimore County Metropolitan District with stations at Fullerton, 5 miles northwest and at Essex, 2 miles southwest of Post Office, answer calls in case of fire.

Four volunteer companies:

Middle River - 1 captain, 2 lieutenants and 30 men.

1 Ford truck with Chrysler pump, capacity 500 G.P.M., 160 gallon booster tank, 500' 2½" hose and 300' 1½" hose.

Bowleys Quarters - 1 captain, 2 lieutenants and 40 men.

1 Mack pumper, capacity 500 G.P.M., 450 gallon booster tank, 1000' 2½" hose and 700' 1½" hose. 1 Willys jeep with Barton pump, capacity 400 G.P.M., 750' 2½" hose.

Middleborough - 1 captain, 2 lieutenants and 25 men.

1 Ford truck with Hale pump, capacity 500 G.P.M., 325 gallon booster tank, 750' 2½" hose and 250' 1½" hose. 200' 2½" hose in reserve.

Rockaway Beach - 1 captain, 3 lieutenants and 38 men.

1 Mack truck with Hale pump, capacity 500 G.P.M., 210 gallon booster tank, 100' 2½" hose, 500' 1½" hose and 300' 1" hose.

Fire alarm by telephone and sirens on Fire Stations.

NO FIRE LIMITS.

NO FIRE-RESISTIVE ROOFING ORDINANCE.

KEY

- FIRE WALL 6 IN. ABV. ROOF
- FIREPROOF CONSTRUCTION
- FIRE WALL 12 IN. ABV. ROOF
- BRICK BUILDING WITH FRAME CORNICE
- FIRE WALL 18 IN. ABV. ROOF
- STONE BUILDING
- HOLLOW CONCRETE OR CEMENT BLOCK
- BRICK VENEERED BUILDING
- FRAME BUILDING
- METAL CLAD BUILDING
- IRON BUILDING
- SKYLIGHT LIGHTING TOP STORY
- 3. SKYLIGHT LIGHTING 3 STORIES
- W.G. WIRED GLASS SKYLIGHT
- BRICK CHIMNEY
- IRON CHIMNEY
- FIRE PUMP
- (O.U.) OPEN UNDER
- WINDOW 1ST STORY
- TILE BUILDING
- WINDOWS 2ND & 3RD STORIES
- WINDOWS WITH IRON SHUTTERS
- STABLE
- E. OPEN FRAME ELEVATOR
- BE. BRICK ENCLOSED ELEVATOR WITH WIRE GLASS DOOR
- A.S. AUTOMATIC SPRINKLERS
- G.W.P. WATER PIPE
- 6 BLOCK NUMBER
- PARTIALLY SPRINKLERED
- D.H. DOUBLE HYDRANT
- 25 REFERENCE NUMBER
- NOT SPRINKL'D
- FIRE DEPARTM'T CONNECTION
- FIRE STATION AS SHOWN ON KEY MAP
- (15) GROUND ELEVATION
- G.T. GASOLINE TANK
- ALTERNATE ST. NOS. ARE ACTUAL CONSECUTIVE ST. NOS. ARE ARBITRARY
- F.A. FIRE ALARM BOX
- V.P.B. VERTICAL STEAM BLR
- I.E.P. INDEPENDENT ELECTRIC PLANT
- A - AUTO. HOUSE
- V.P. VERTICAL PIPE OR STAND PIPE

CORRECTION RECORD

REV'N NO.	DATE OF CORRECTION	ATTACHED BY	DATE ATTACHED