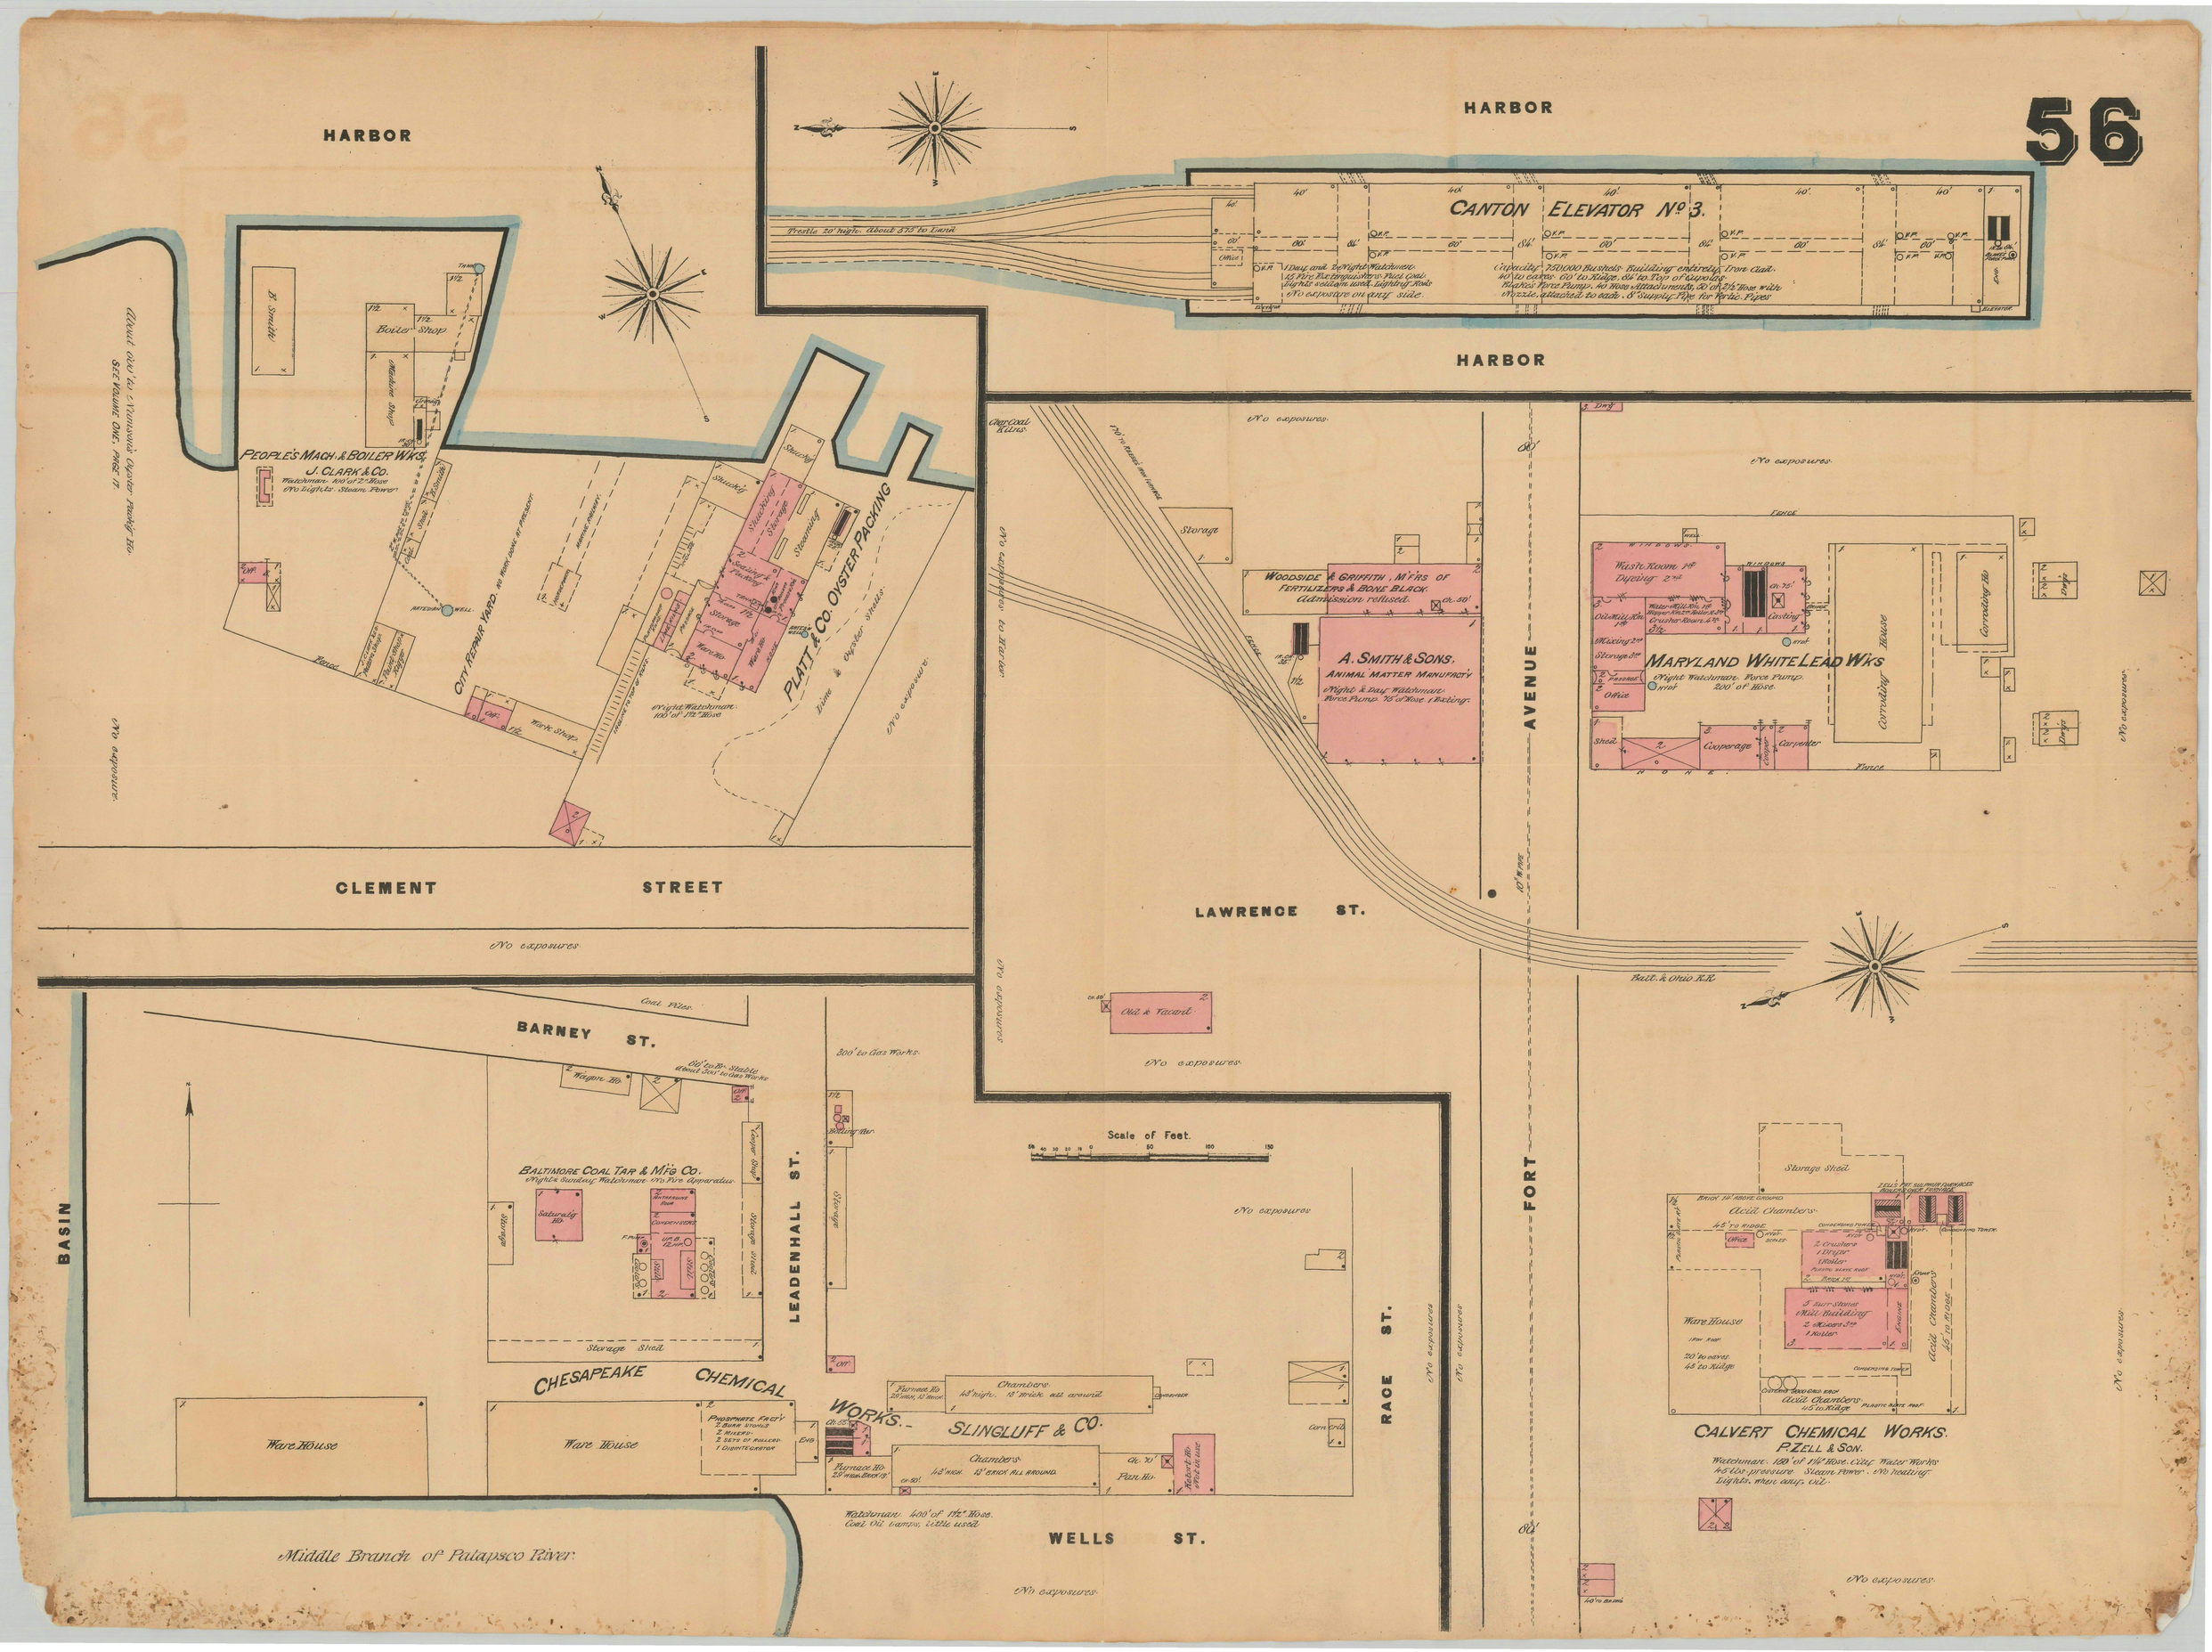
HARBOR
HARBOR
HARBOR
CANTON ELEVATOR No 3.
Trestle 20' high, about 375' to Bank.
1 Day and 2 Night Watchmen.
15 Fire Extinguishers. Fuel Coal.
Lights seldom used, lighting Rooms
No exposure on any side.
Capacity 750,000 Bushels. Building entirely Iron Clad.
40' to eaves. 60' to Ridge. 84' to Top of Cupola.
Blake's Force Pump. 40 Hose attachments, 50 of 2½" Hose with nozzle, attached to each. 8" Supply Pipe for Portic. Pipes
Office
Elevator
Boiler Shop
Machine Shop
Smith
PEOPLE'S MACH. & BOILER WK'S.
J. CLARK & CO.
Watchman. 400' of 2" Hose
No Lights. Steam Power
Tank
Well
Cut Repair Yard. No work done at present.
Work Shop
Cap.
Stacking
Storage
Stacking & Packing
Men's Ho.
Women's Ho.
Steam Pipe
Engine
Boiler
Water Closet
Entrance to Yard
Entrance to Factory
Entrance to Office
Entrance to Wharf
Entrance to Stacking
Entrance to Storage
Entrance to Men's Ho.
Entrance to Women's Ho.
Entrance to Engine
Entrance to Boiler
Entrance to Water Closet
Entrance to Steam Pipe
Entrance to Machine Shop
Entrance to Blacksmith Shop
Entrance to Boiler Shop
Entrance to Machine Shop
Entrance to Work Shop
Entrance to Cap.
Entrance to Tank
Entrance to Well
Entrance to Smith
Entrance to Office
Entrance to Elevator
Entrance to Trestle
Entrance to Dock
Entrance to Bank
Entrance to Trestle
Entrance to Dock
Entrance to Bank
Entrance to Trestle
Entrance to Dock
Entrance to Bank